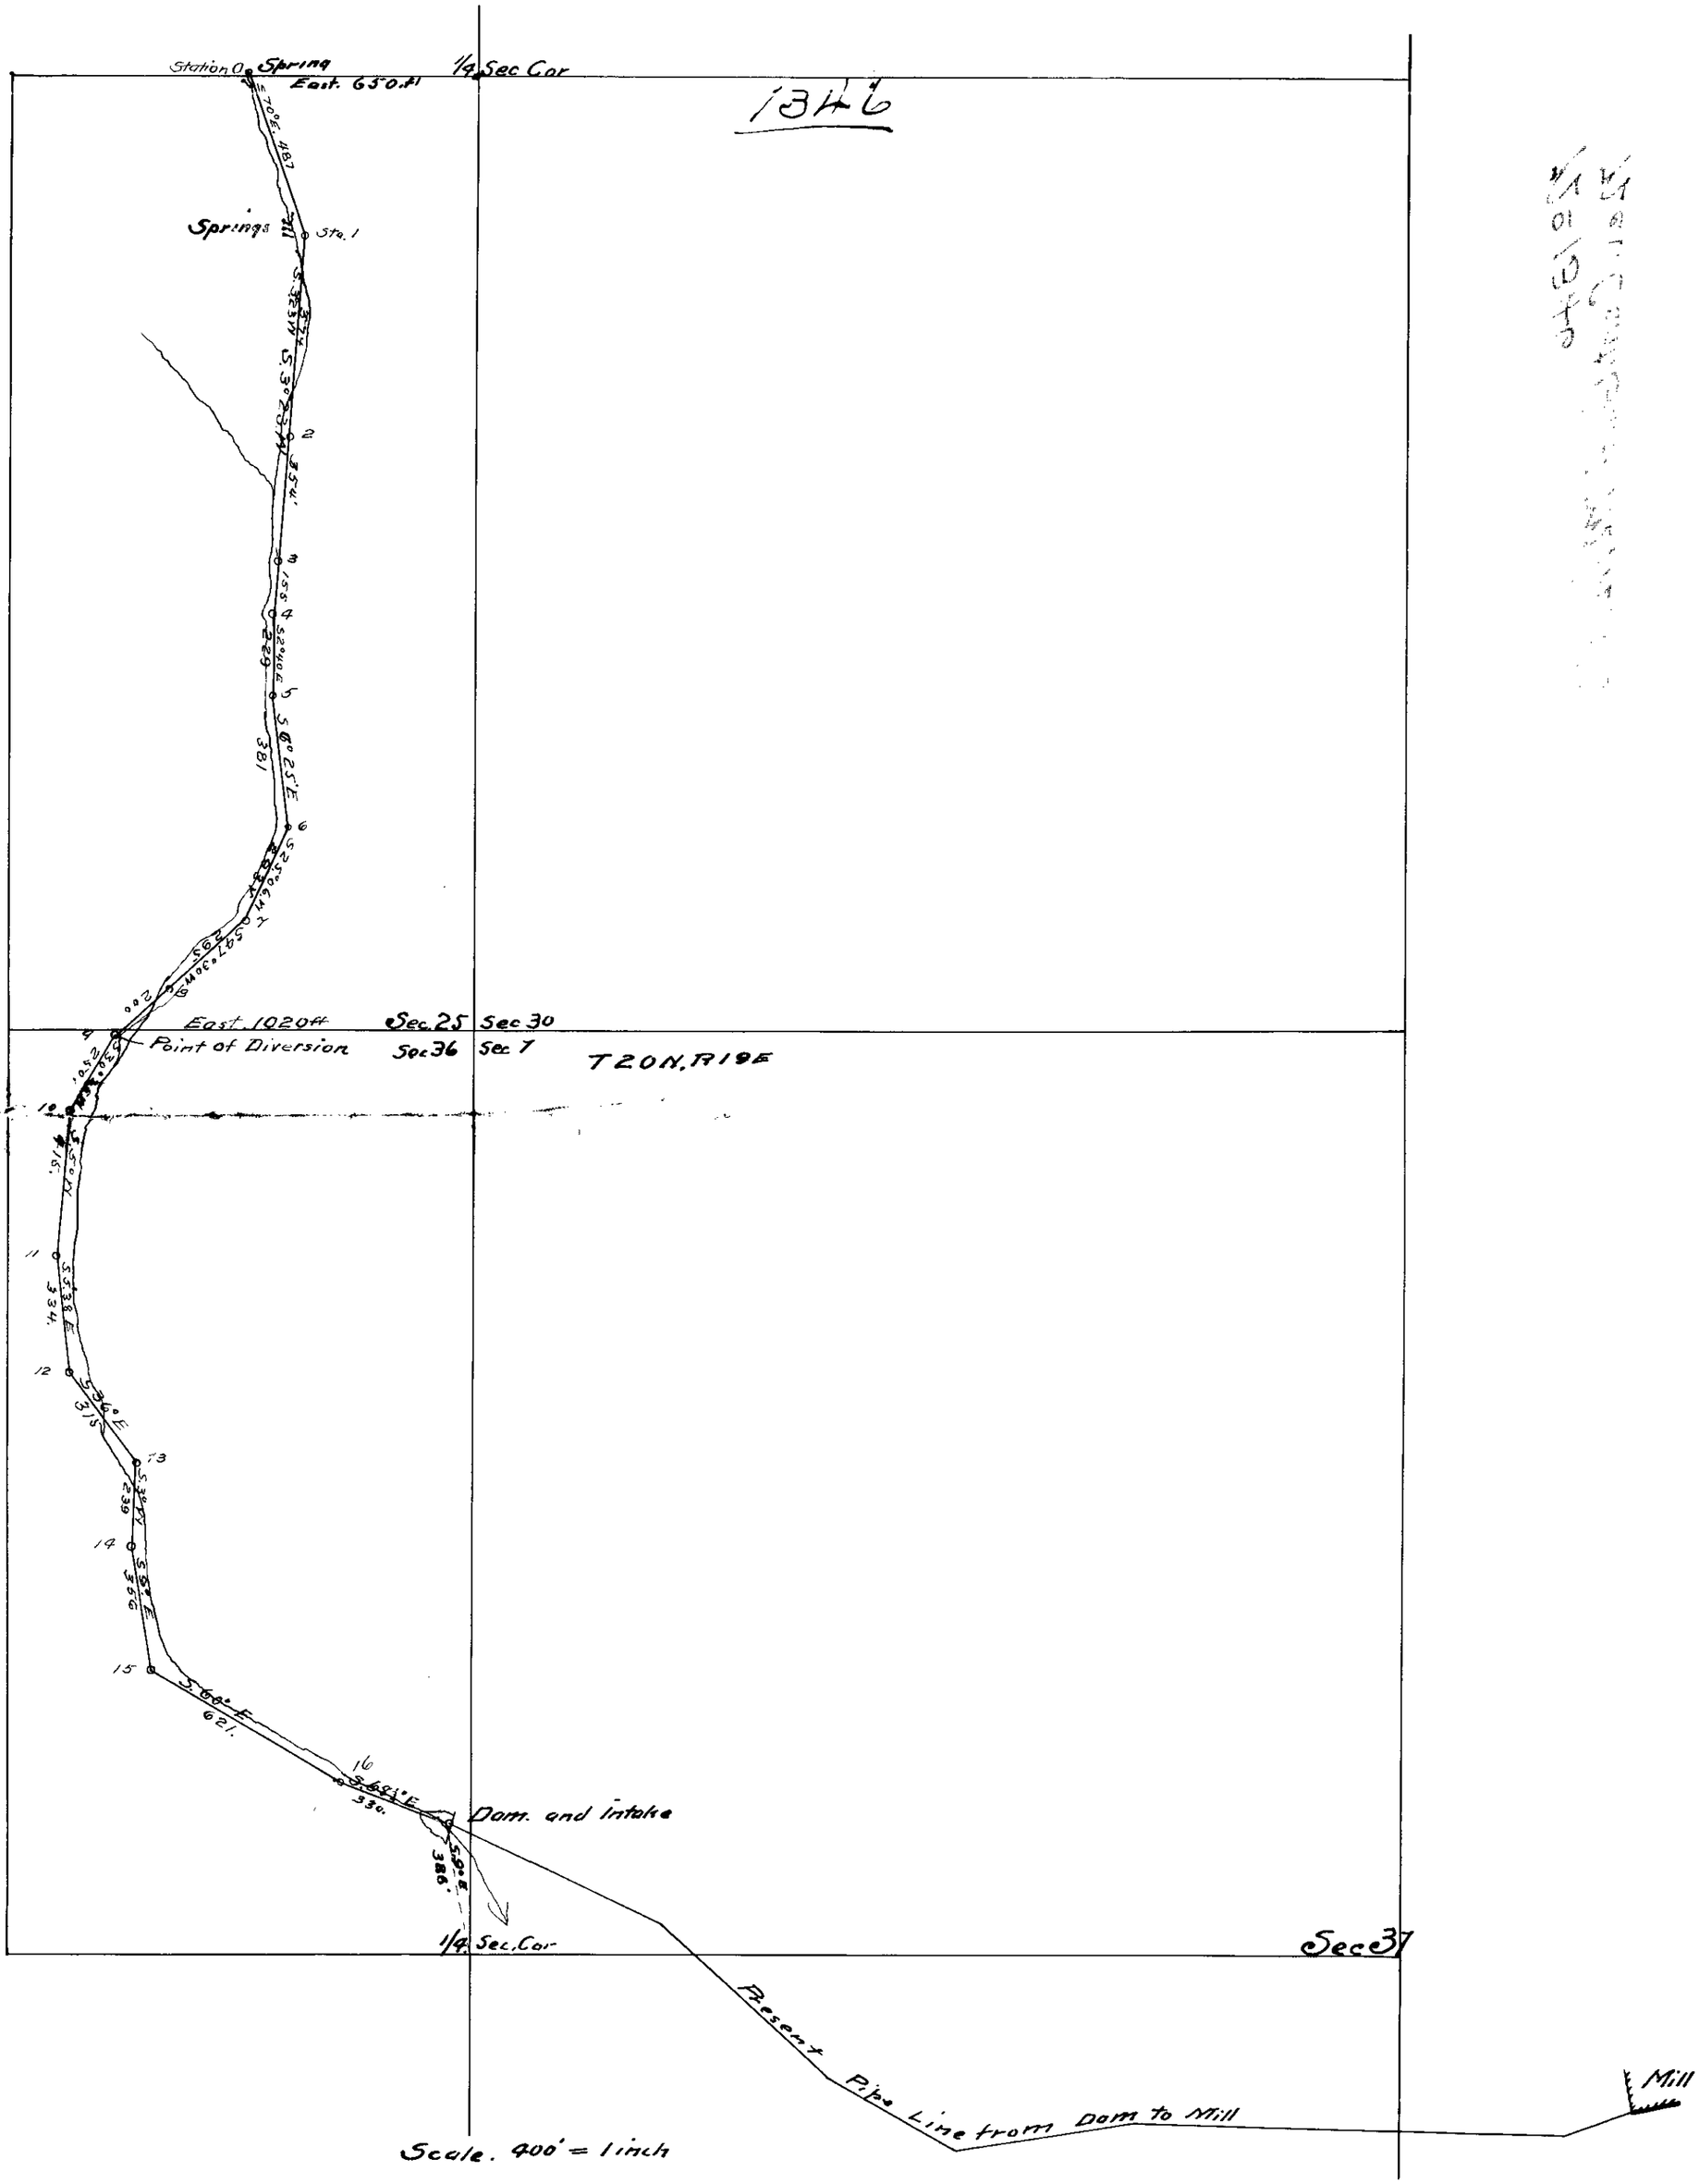
Station 0
Spring
East. 650 ft
1/4 Sec Cor
1346
Springs
Sta. 1
East. 1020 ft
Point of Diversion
Sec. 25
Sec 30
Sec 36
Sec 1
T 20 N, R 19 E
Dam. and Intake
1/4 Sec. Cor
Sec 31
Present Pipe Line from Dam to Mill
Mill
Scale. 400' = 1 inch

1346

WATER SUPPLY
FOR
NEVADA CENTRAL G. M. CO'S. MILL
72 = 1346 - 1347.

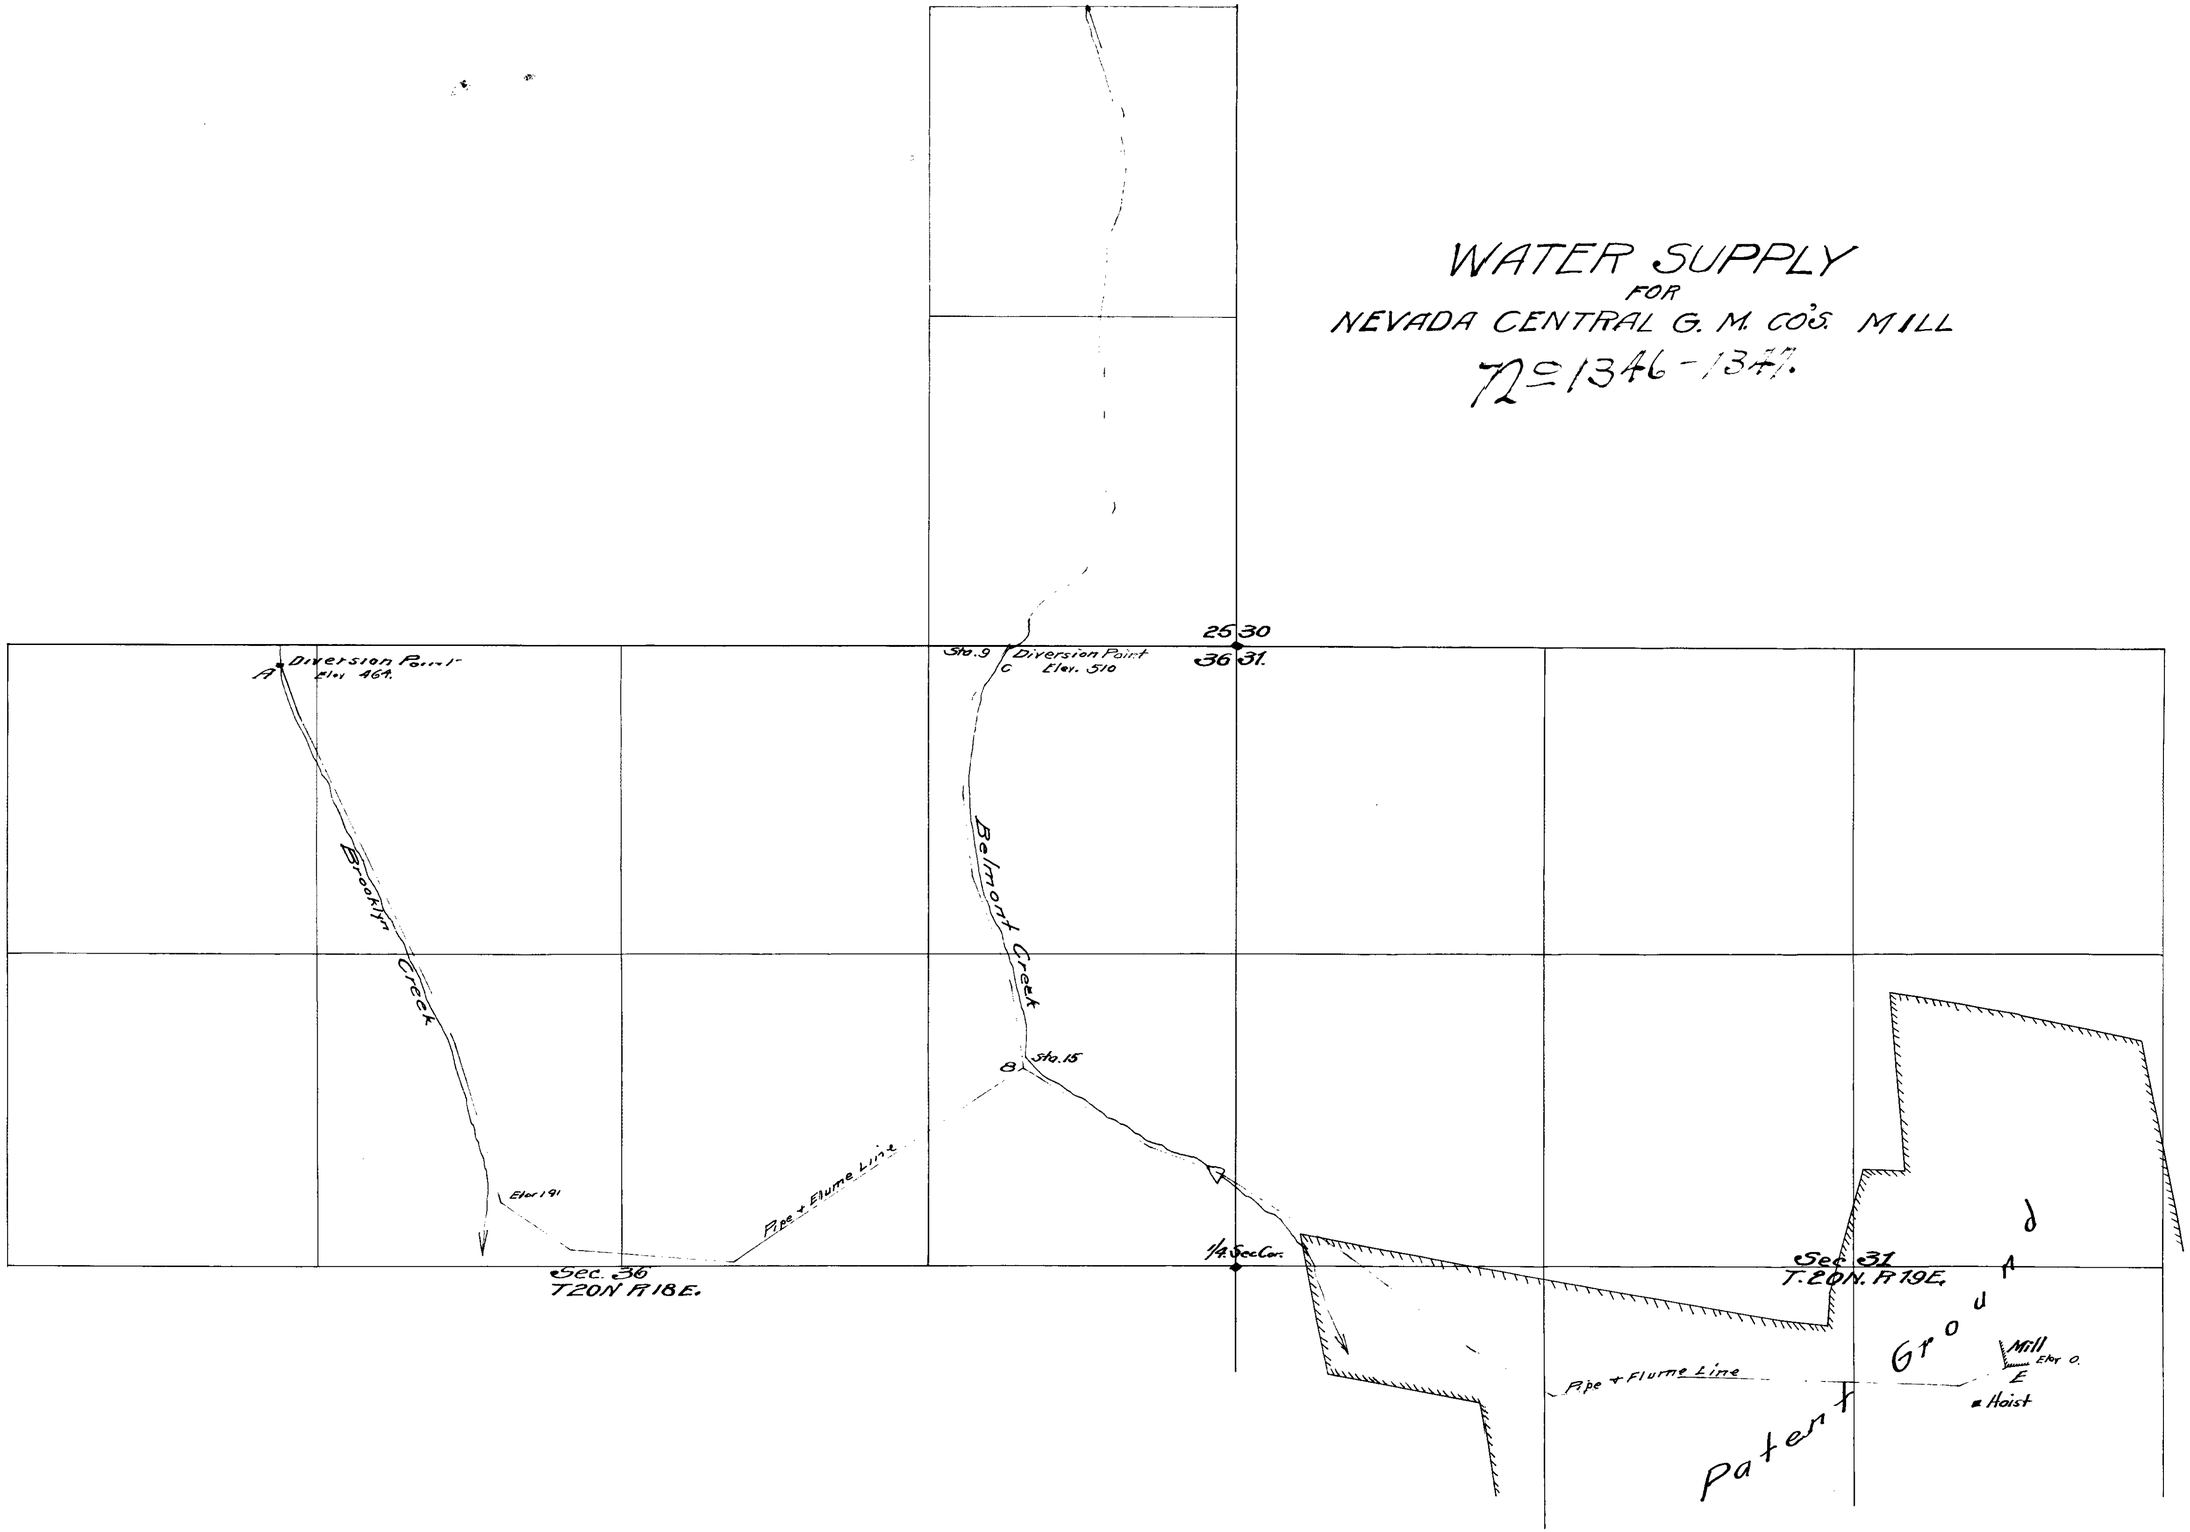

1347 - 1346