2100

W[redacted] PERMIT No 2100

G[redacted]E D. MADDALENA

GH[redacted]REEK, NEVADA

PINE COUNTY

O.E. MANN
CIVIL ENGINER-EL[redacted]A
June 6th 1911

SCALE
26 Inches = 1 Mile

Quantity of Water	.50 Cubic Feet per second
Source of Supply	Flint Springs
Point of Diversion	S.73°E. 1771.5' from ¼ Cor. between Secs 14-15 Tp 24 N. R. 62 E. M.D.M.
Used for	Stock and Domestic purposes
Diversion Works	Cut, Pipes, Troughs.
Cut	10' long, 3' wide, 3' Face
Pipe	4" 3.7' to 1st trough, 125' to 2nd trough.
Troughs	Capacity 100 Gal. each. Full June 6th 1911

State of Nevada
County of White Pine } S.S.

O.E. Mann a Civil Engineer of Ely, White Pine County, Nevada being sworn duly sworn on oath says: That this Map is a correct representation of a field survey made by him on the 6th day of June A.D. 1911 on which date the Diversion Works where complete and Water to the capacity of the troughs in storage.

O.E. Mann

Acknowledged, Subscribed and Sworn to before me this 29th day of June A.D. 1911

J.M. Lockhart
Notary Public

My Commision Expires Feby. 7. 1912.

FILED
DEC [illegible] 1911
STATE ENGINEER'S OFFICE

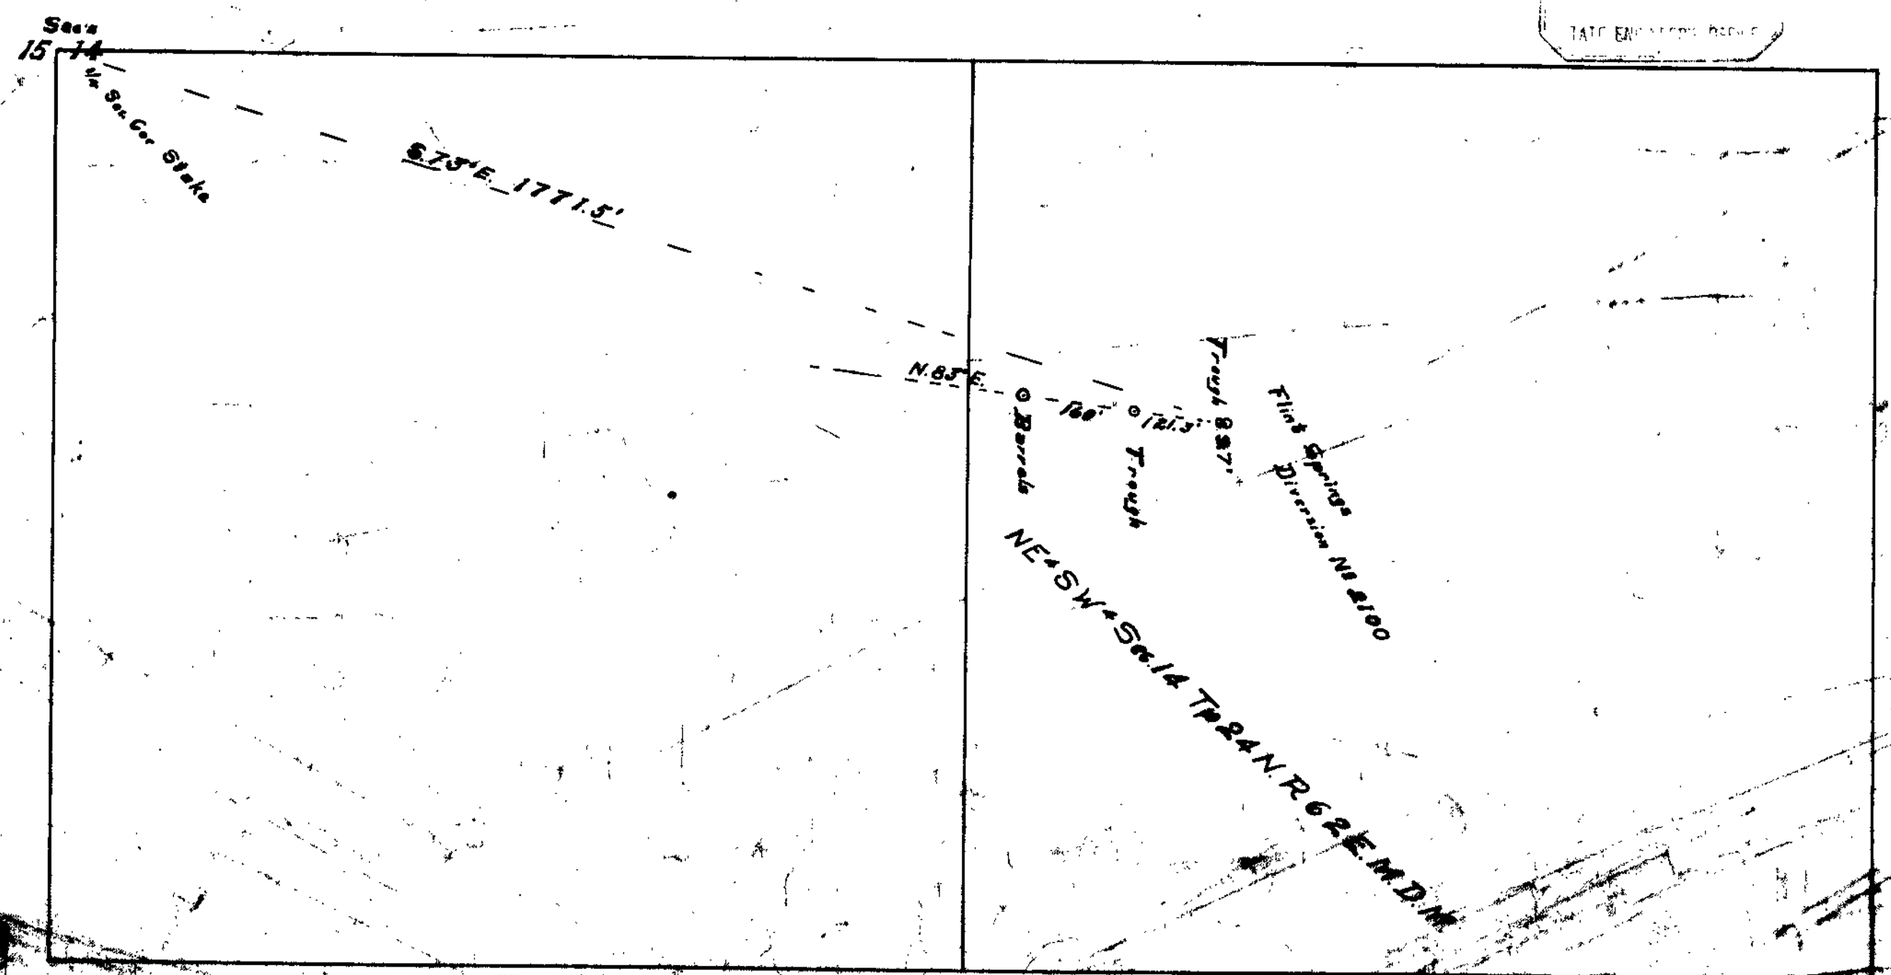

30 Bk 3
For 0.025 c.f.s.
6-25

2100