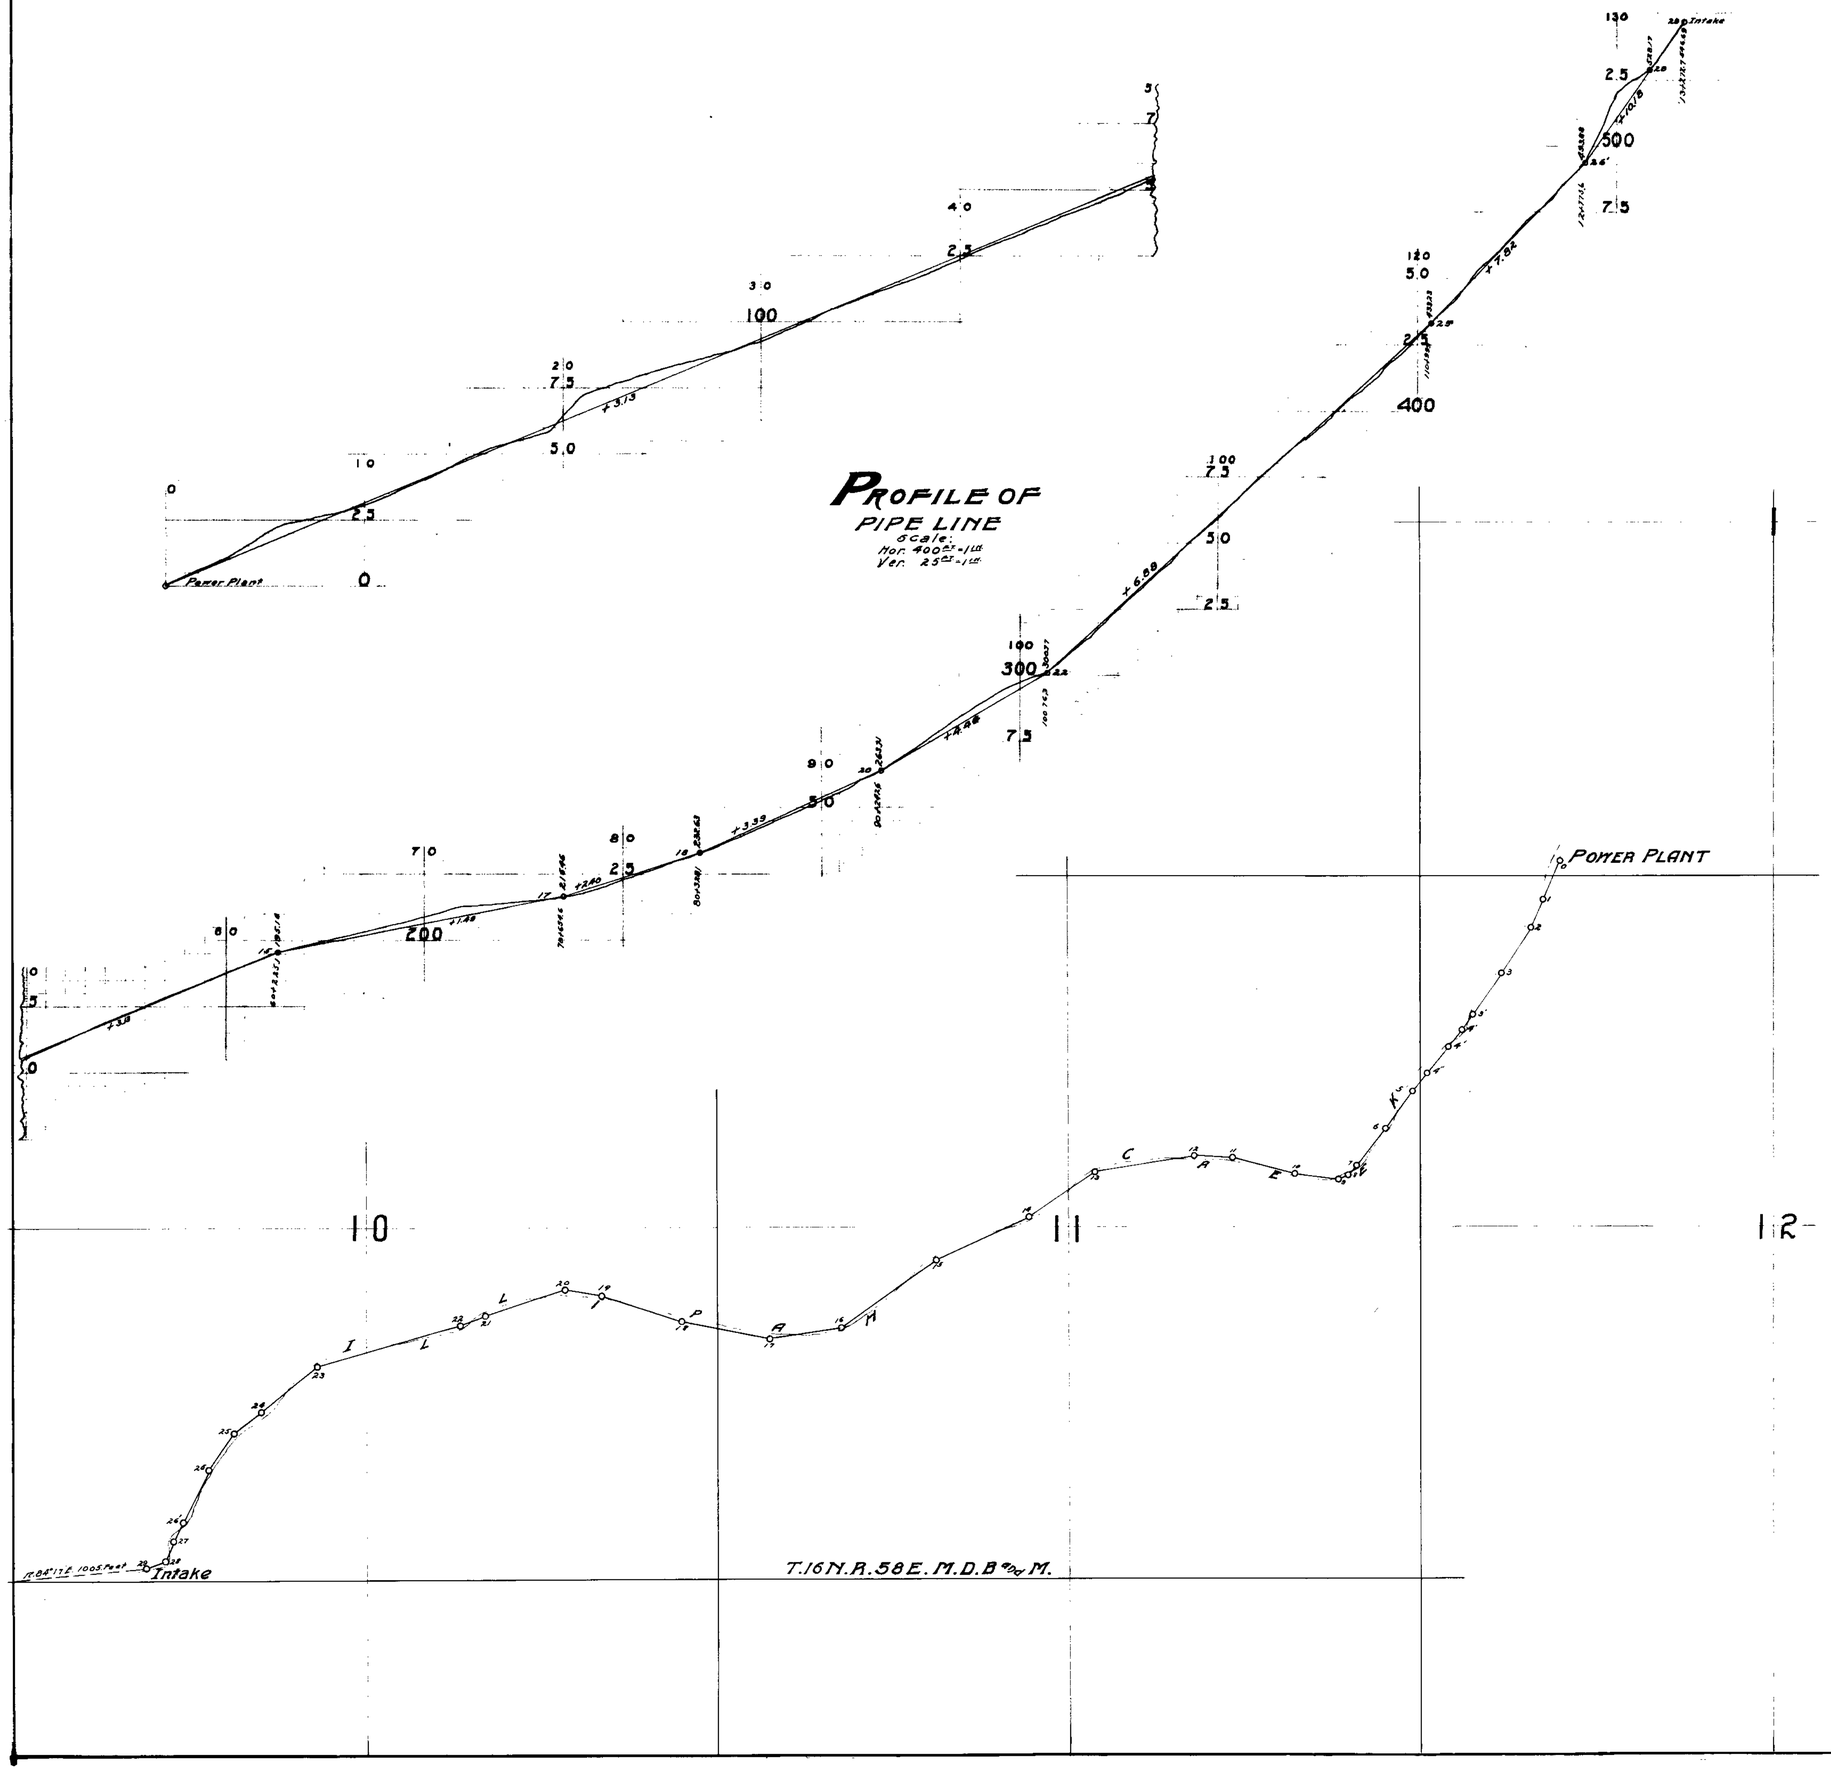

Traverse of Pipe Line

Station	Course	Distance	Elevation
0 to 1	S. 23° 44' W.	323.60	0.00 - 11.38
1 " 2	S. 23° 44' W.	228.50	22.54
2 " 3	S. 32° 45' W.	419.00	29.67
3 " 3'	S. 34° 52' W.	382.50	42.64
3 " 4	S. 34° 52' W.	524.30	48.35
4 " 4'	S. 39° 16' W.	163.50	53.34
4 " 4"	S. 39° 16' W.	414.90	58.24
4 " 5	S. 39° 16' W.	587.70	72.81
5 " 6	S. 35° 54' W.	395.70	82.33
6 " 7	S. 38° 58' W.	347.60	89.37
7 " 8	S. 38° 58' W.	100.80	91.77
8 " 9	S. 67° 58' W.	77.90	93.65
9 " 10	N. 82° 24' W.	323.90	105.18
10 " 11	N. 75° 26' W.	484.40	118.16
11 " 12	N. 87° 51' W.	292.50	128.20
12 " 13	S. 80° 53' W.	761.00	152.01
13 " 14	S. 55° 46' W.	597.20	172.02
14 " 15	S. 65° 01' W.	766.00	195.16
15 " 16	S. 54° 43' W.	881.50	212.17
16 " 17	S. 81° 19' W.	548.00	216.46
17 " 18	N. 78° 43' W.	673.50	232.63
18 " 19	N. 72° 26' W.	633.20	253.00
19 " 20	N. 80° 36' W.	281.80	263.71
20 " 21	S. 72° 11' W.	631.00	296.08
21 " 22	S. 68° 32' W.	202.70	300.77
22 " 23	S. 74° 13' W.	1119.00	377.99
23 " 24	S. 51° 07' W.	544.60	417.73
24 " 25	S. 52° 33' W.	259.10	433.23
25 " 26	S. 34° 45' W.	335.60	460.42
26 " 26'	S. 25° 57' W.	439.00	493.88
26 " 27	S. 25° 57' W.	602.30	521.47
27 " 28	S. 21° 42' W.	160.70	528.17
28 " 29	S. 57° 30' W.	175.10	546.69
29 to Intake 1005.00	S. 84° 17' W.	1005.00	

State of Nevada
County of White Pine } ss.

J. W. Nyce, being first duly sworn, deposes and says that the above map is a true and accurate plat of the alignment and grades of the Power Line as surveyed by him for the "Hamilton, Power, Mining, and Transportation Co." M. B. Bierce, Manager and applicant (No. 2481).

J. W. Nyce
Surveyor.

Subscribed and sworn to before me this day of August, 1913.

J. M. Lockhart
Notary Public, in and for White Pine County, Nevada.

PLAT

Showing the
HAMILTON POWER MINING and TRANSPORTATION CO'S.
PIPE LINE SURVEY
For Power Purposes (Appl. No. 2481)
FROM
Diversion point on Illipah
Creek to Power House Site,
Illipah Creek
Scale: 600 FT = 1 IN.

2481