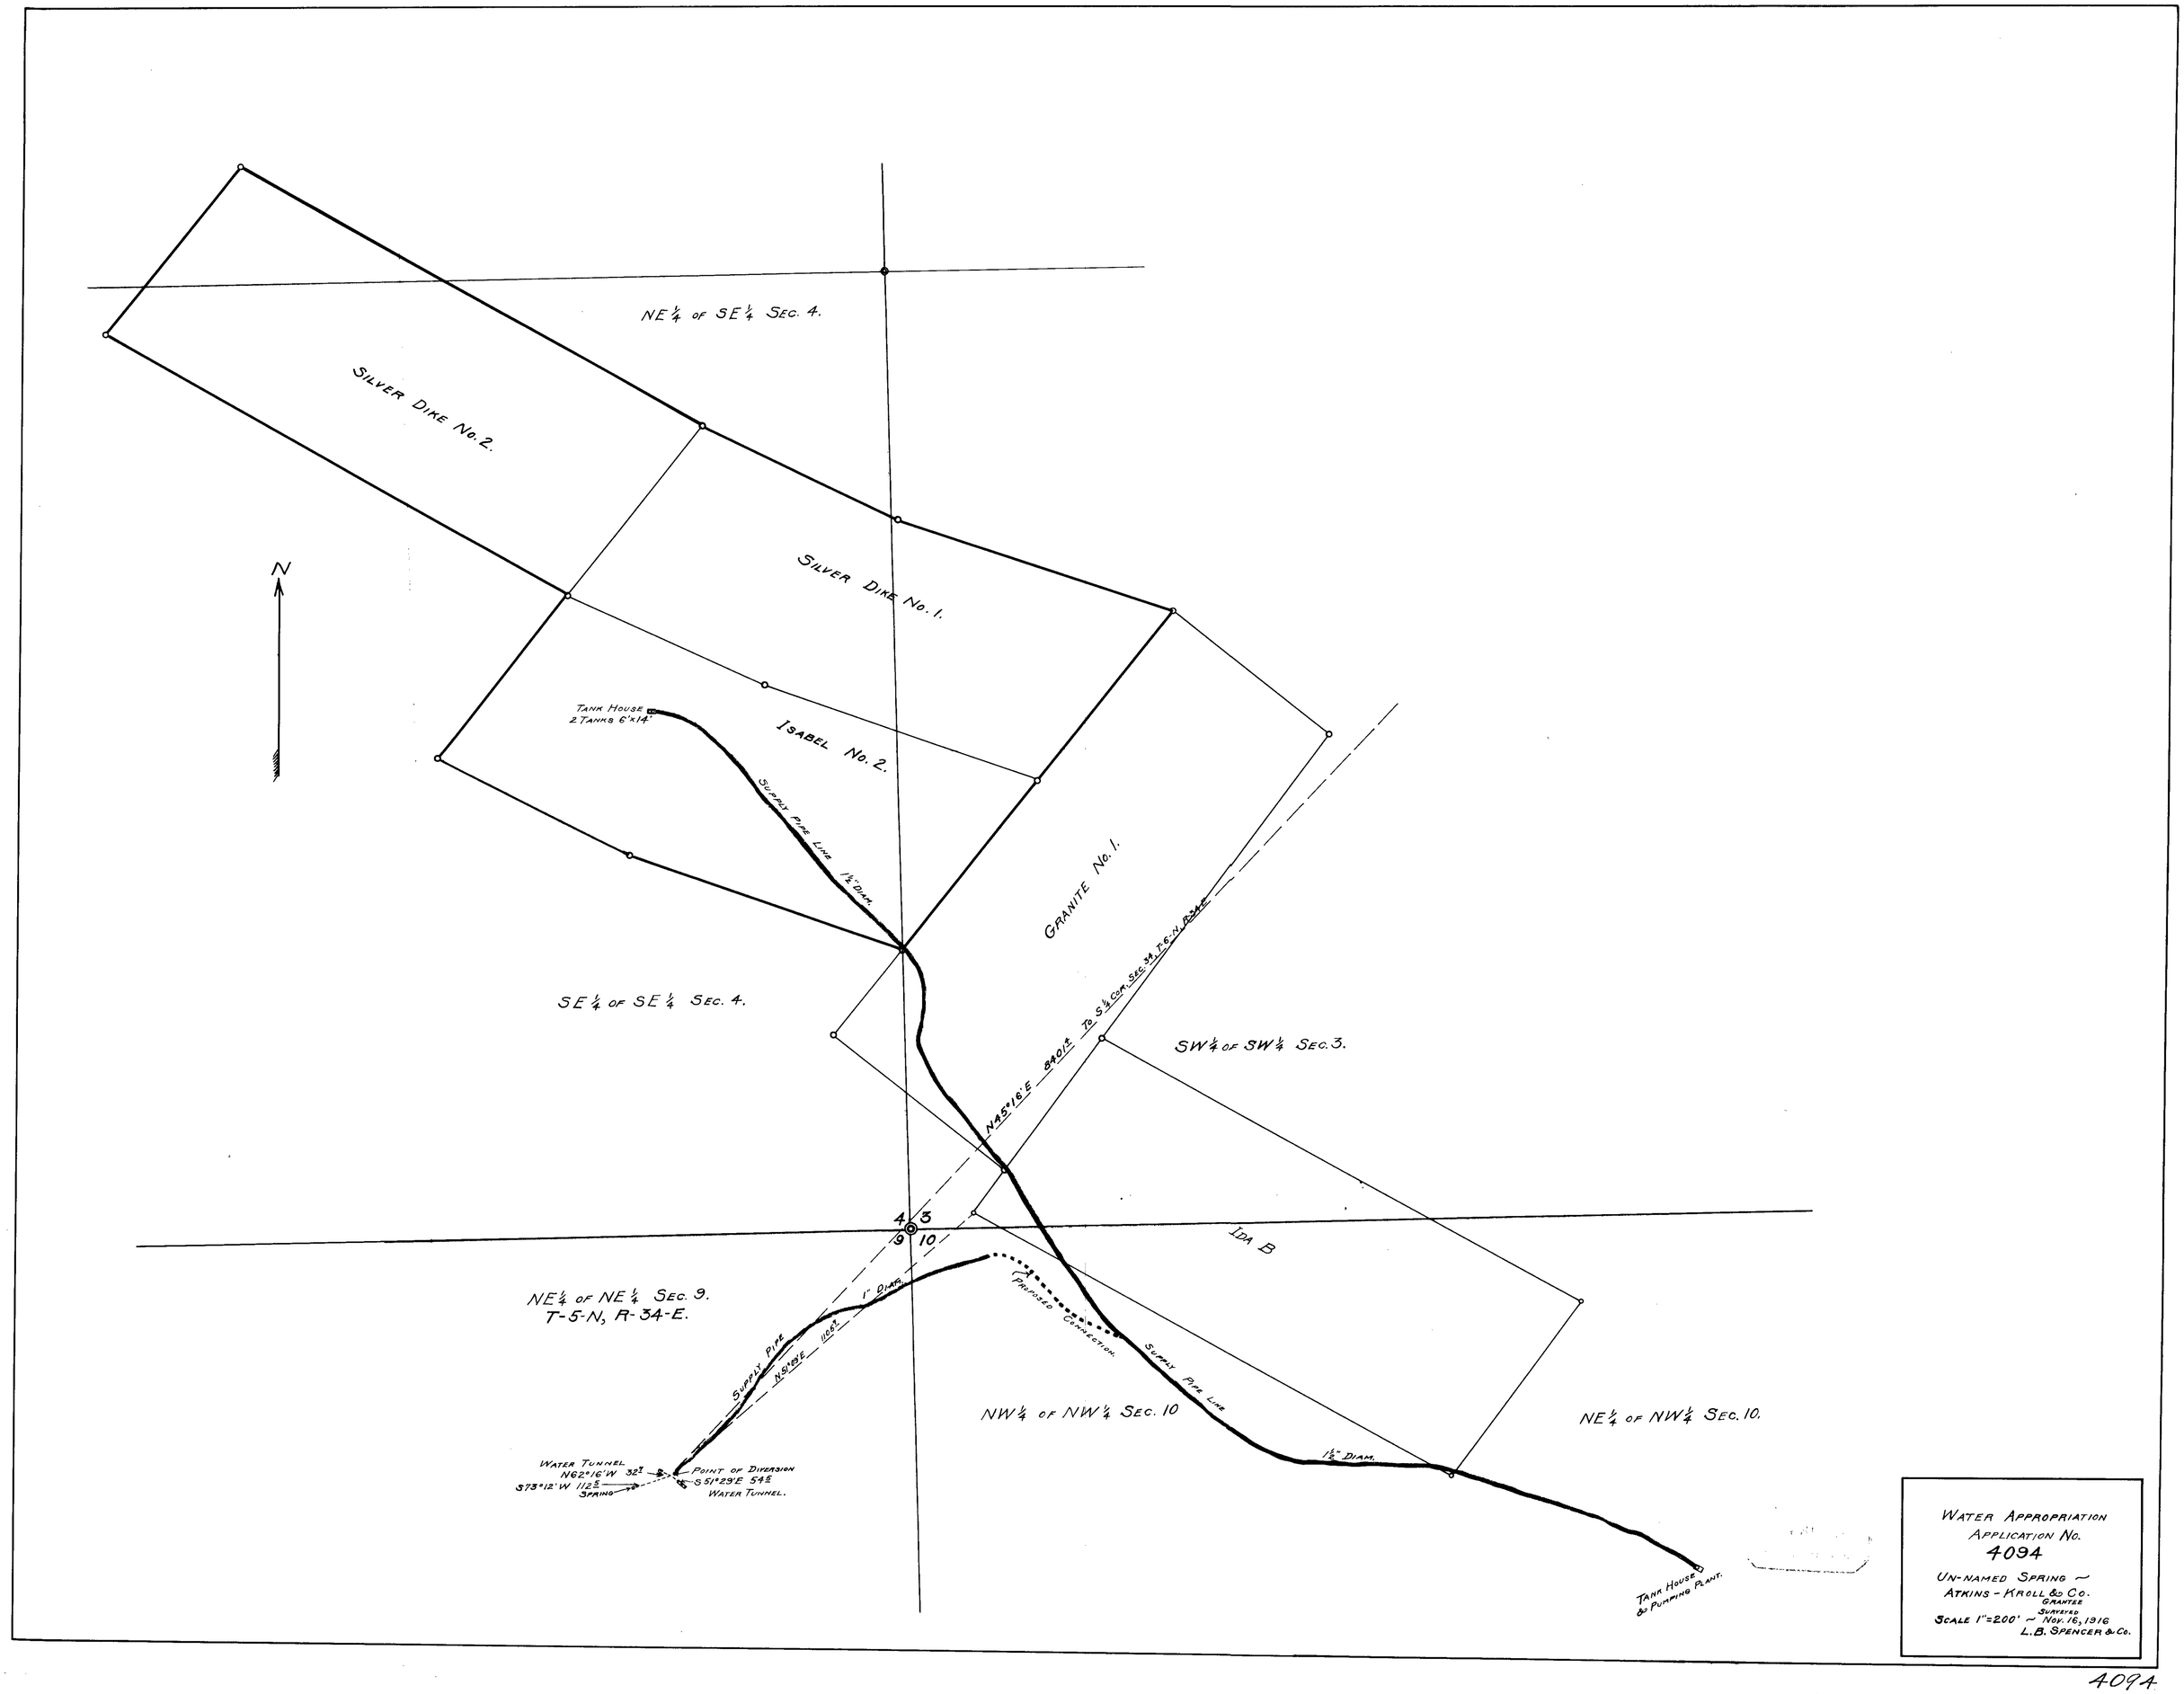
NE¼ of SE¼ Sec. 4.
Silver Dike No. 2.
Silver Dike No. 1.
N
Tank House
2 Tanks 6'x14'
Isabel No. 2.
Supply Pipe Line 1½" Diam.
Granite No. 1.
SE¼ of SE¼ Sec. 4.
N45°16'E 840±
To S¼ Cor. Sec. 34, T-6-N, R-34-E
SW¼ of SW¼ Sec. 3.
4
3
9
10
Ida B
NE¼ of NE¼ Sec. 9.
T-5-N, R-34-E.
1" Diam.
Supply Pipe
N51°09'E 1105±
Proposed Connection.
Supply Pipe Line
NW¼ of NW¼ Sec. 10
NE¼ of NW¼ Sec. 10.
1½" Diam.
Water Tunnel
N62°16'W 32±
S73°12'W 112±
Spring
Point of Diversion
S51°29'E 54±
Water Tunnel.
Tank House
& Pumping Plant.
Water Appropriation
Application No.
4094
Un-named Spring ~
Atkins - Kroll & Co.
Grantee
Scale 1"=200' ~ Surveyed Nov. 16, 1916
L.B. Spencer & Co.

4094