works at point of diversion: Catch basin 20 feet long, 8 feet wide and 3 feet deep connected to a storage tank 11 feet long, 2½ feet wide and 2 feet deep by two-1¾ inch pipes - 30 feet long. Storage tank connected to 72 feet of galvanized iron trough. The catch basin and spring are inclosed by a fence.

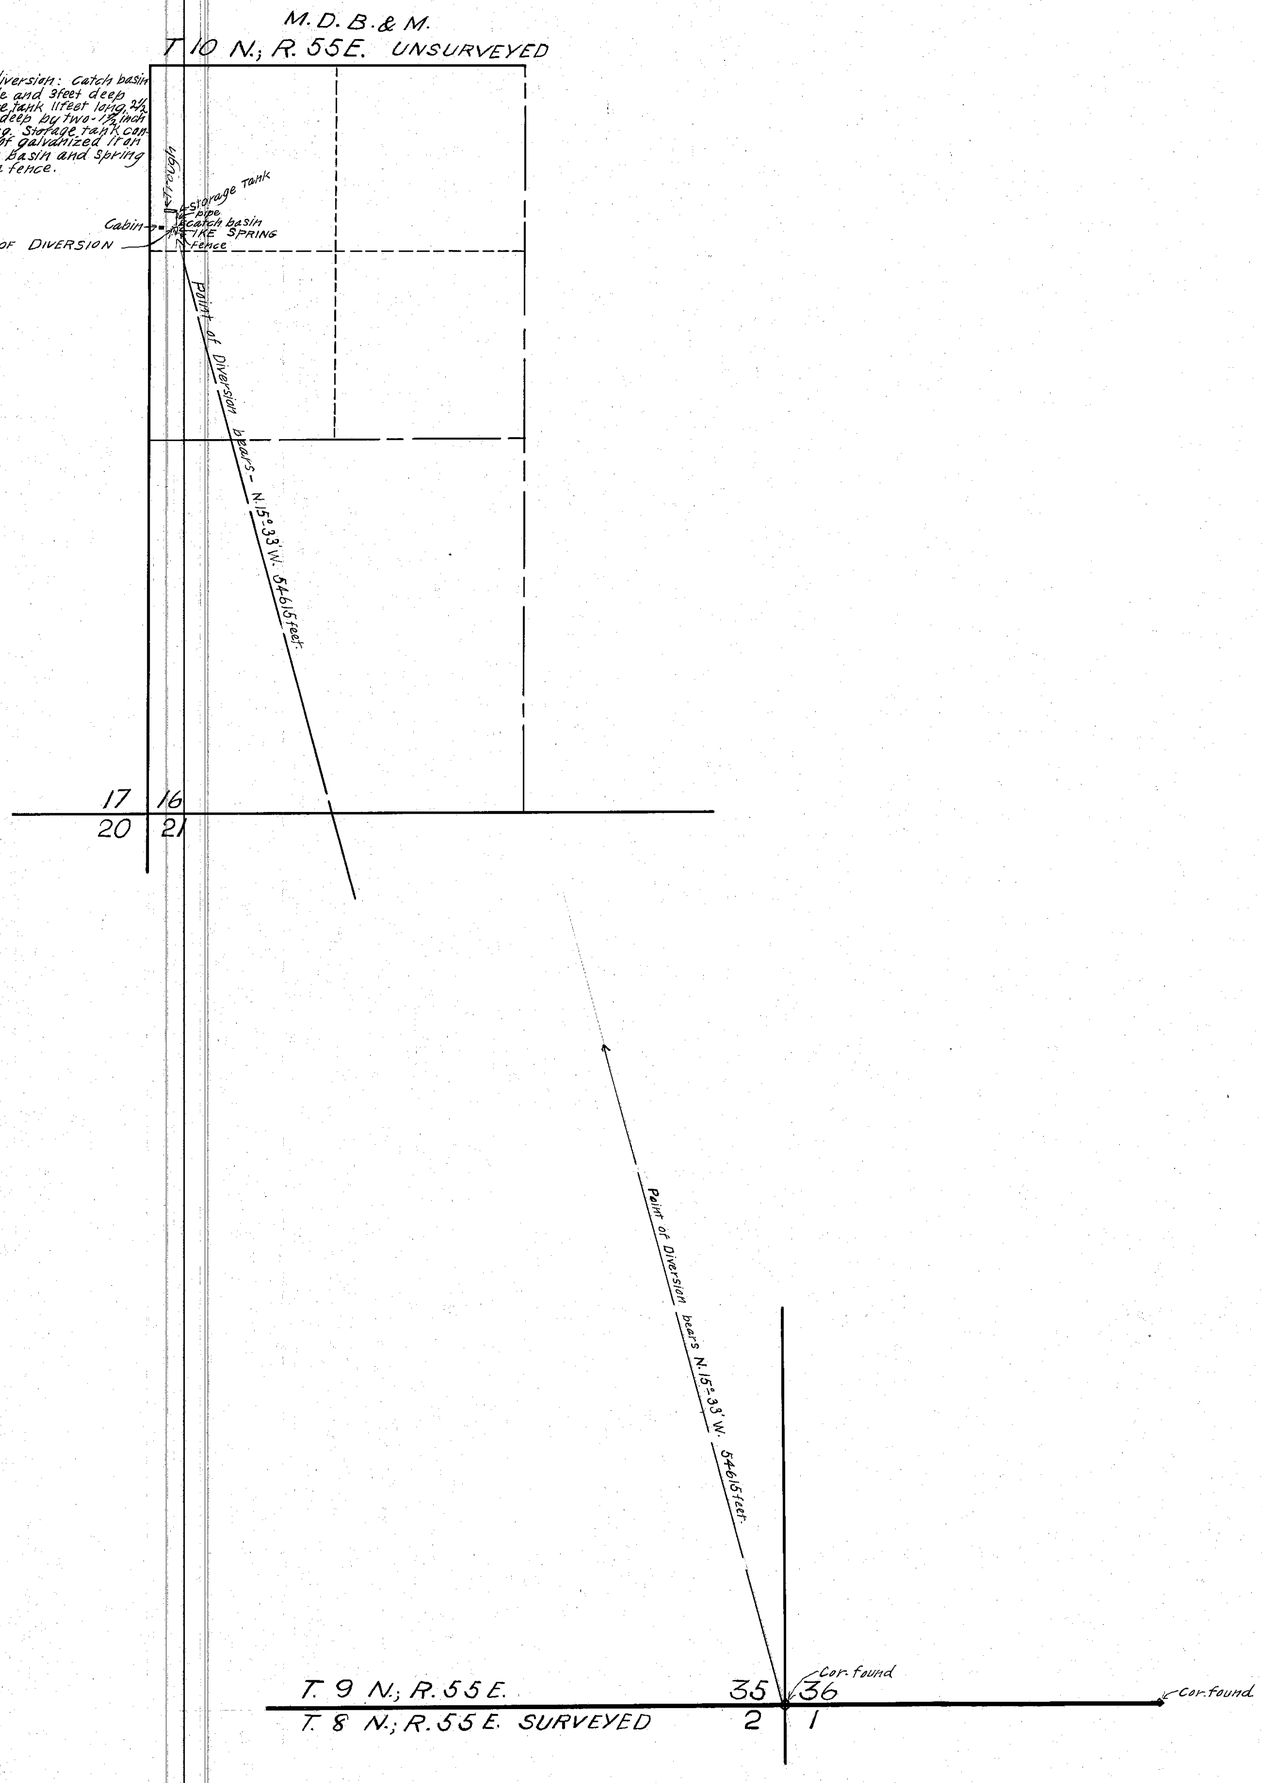

STATE OF NEVADA }
COUNTY OF WHITE PINE } S.S.

I, G.T. Saxton, being first duly sworn, depose and say that this map, consisting of one sheet, has been correctly drawn to the designated scale from field notes of a survey made by me between the 6 and 9 days of June, 1929; that it truly and correctly represents the location and extent of the works used to divert water from Ike Spring, in Nye County, by F.C. Vanover for Stockwatering purposes; that the point of diversion, the location and size of the diverting conduit, the place and manner of use and the location and names of all other works or streams which are crossed by or connected with the said works, are fully and correctly designated thereon.

Geo. T. Saxton
STATE WATER RIGHT SURVEYOR

Subscribed and sworn to before me this 30th day of July, 1929.
Radyo McKenzie
NOTARY PUBLIC IN AND FOR WHITE PINE COUNTY, NEVADA.

SCALE: 1 IN. = 600 Feet.

0 200 400 600 800 1000 2000 3000 Feet

MAP TO ACCOMPANY
PROOF OF APPROPRIATION
FOR
STOCKWATERING
BY
F.C. VANOVER
FROM
IKE SPRING

FILED
September 3, 1929
STATE ENGINEER'S OFFICE

02209