WHITE—DIVISION OF WATER RESOURCES
CANARY—CLIENT'S COPY
PINK—WELL DRILLER'S COPY

PRINT OR TYPE ONLY
DO NOT WRITE ON BACK

STATE OF NEVADA
DIVISION OF WATER RESOURCES

WELL DRILLER'S REPORT

Please complete this form in its entirety in accordance with NRS 534.170 and NAC 534.340

OFFICE USE ONLY
Log No. 37453
Permit No.
Basin 101

NOTICE OF INTENT NO.

1. OWNER
MAILING ADDRESS

ADDRESS AT WELL LOCATION Fallon Naval Air Station

2. LOCATION NE ¼ SW ¼ Sec. 23 T. 18 N/S R. 29 E. Church Hill County

PERMIT NO. MO 200 A (Issued by Water Resources) | Parcel No. | Subdivision Name

3. WORK PERFORMED
☒ New Well ☐ Replace ☐ Recondition
☐ Deepen ☐ Abandon ☐ Other

4. PROPOSED USE
☐ Domestic ☐ Irrigation ☐ Test
☐ Municipal/Industrial ☒ Monitor ☐ Stock

5. WELL TYPE
☐ Cable ☐ Rotary ☐ RVC
☐ Air ☐ Other Auger

6. LITHOLOGIC LOG MW-66

Material	Water Strata	From	To	Thickness
Brown Sand		0		
Dry			4	4
Dark gray		4		
Silty Sand			7	3
clayey silt		7		
with fine layer				
of sand			14	7
Silty Sand		14		
Olive in color				
(fine)			17	3
Silty clay		17		
Dark Olive in				
color			22	5

* 3 Ft By 3 Ft Concrete Well PAD with 6" Water Tight Well cover

Date started 11-25, 1991
Date completed 11-25, 1991

7. WELL TEST DATA
TEST METHOD: ☐ Bailer ☐ Pump ☐ Air Lift

G.P.M.	Draw Down (Feet Below Static)	Time (Hours)

STATE ENGINEERS OFFICE
DEC 19 AM 11:44

8. WELL CONSTRUCTION
Depth Drilled 22 Feet Depth Cased 13 Feet

HOLE DIAMETER (BIT SIZE)

	From	To
7 5/8 Inches	0 Feet	22 Feet
Inches	Feet	Feet
Inches	Feet	Feet

CASING SCHEDULE

Size O.D. (Inches)	Weight/Ft. (Pounds)	Wall Thickness (Inches)	From (Feet)	To (Feet)
2"		Sch 40 PVC	0	3

Perforations:
Type perforation Slot Sch 40 PVC
Size perforation .010
From 3 feet to 13 feet
From feet to feet
From feet to feet
From feet to feet
From feet to feet

Surface Seal: ☒ Yes ☐ No
Depth of Seal 1
Placement Method: ☐ Pumped ☒ Poured
Seal Type: ☐ Neat Cement ☐ Cement Grout ☒ Concrete Grout

Gravel Packed: ☒ Yes ☐ No
From 2 feet to 22 feet

9. WATER LEVEL
Static water level 4.5 feet below land surface
Artesian flow G.P.M. P.S.I.
Water temperature °F Quality

10. DRILLER'S CERTIFICATION
This well was drilled under my supervision and the report is true to the best of my knowledge.

Name Contractor
Address Contractor

Nevada contractor's license number issued by the State Contractor's Board
Nevada driller's license number issued by the Division of Water Resources, the on-site driller 1470

Signed [signature]
By driller performing actual drilling on site or contractor
Date 12-18-91

(Rev. 3-91)

USE ADDITIONAL SHEETS IF NECESSARY

(O)-627

MW-66

Loc# 31433
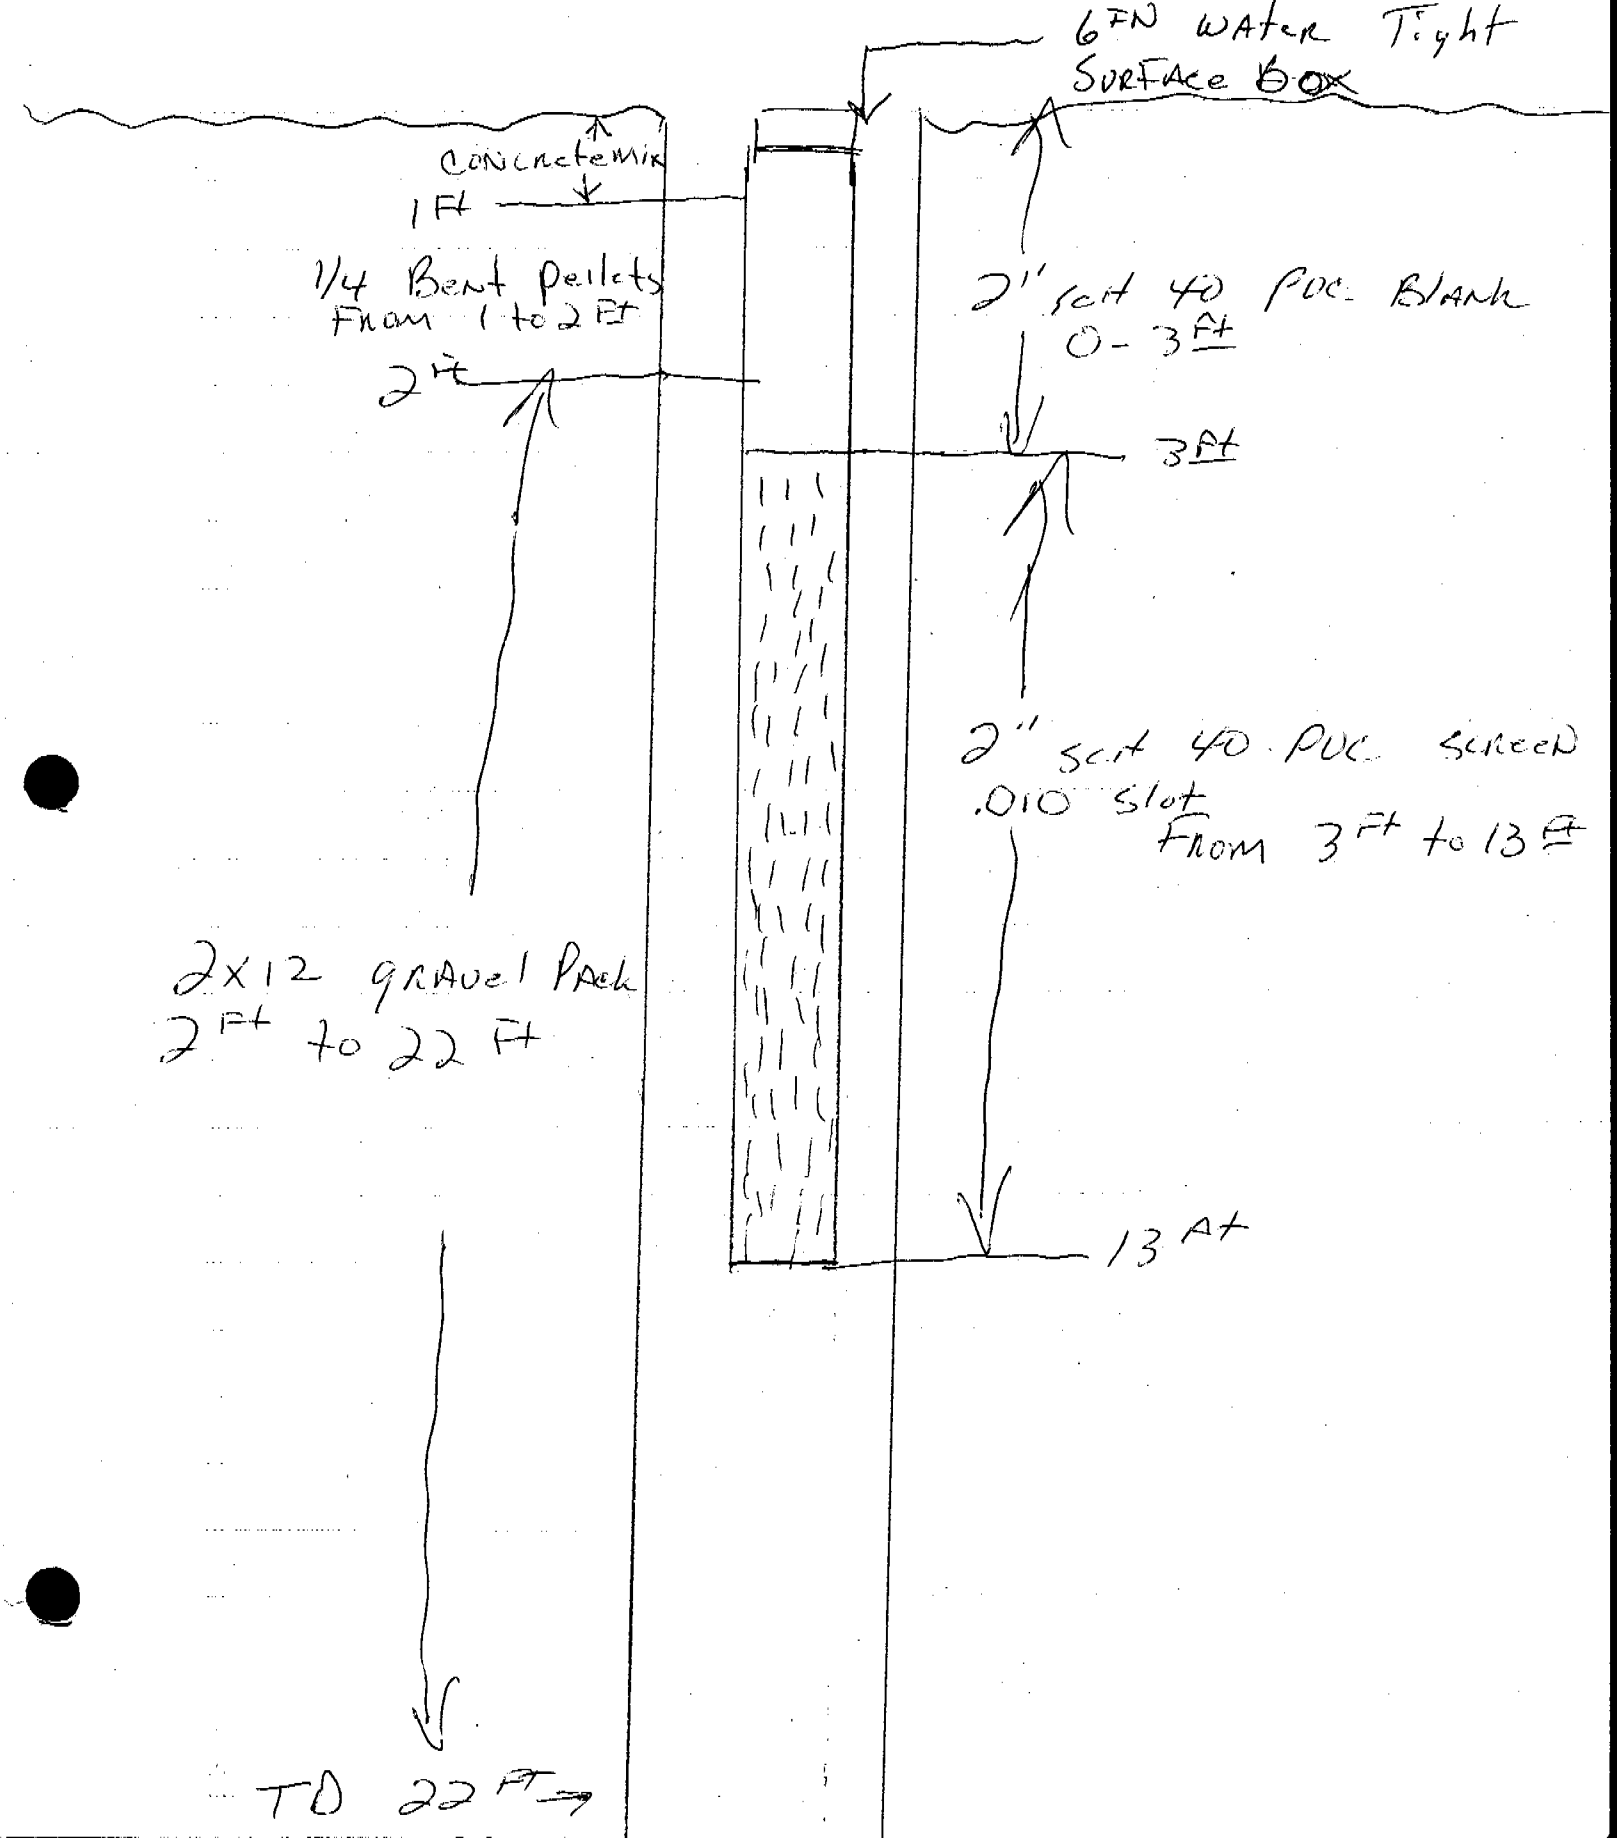
FALLON NAVAL AIR STATION