Log 748 74584

Shell oil - Incline Village / - 5-5

Well tried to Be Abanded, but Snap of at 6' Below G.L.

Call Water Resource office, and talk to Jason King. Friday oct. 9 afternoon about (1:00pm to 2:00pm). Decide to insert 3" PVC inside 4" PVC, and cement back to surface.

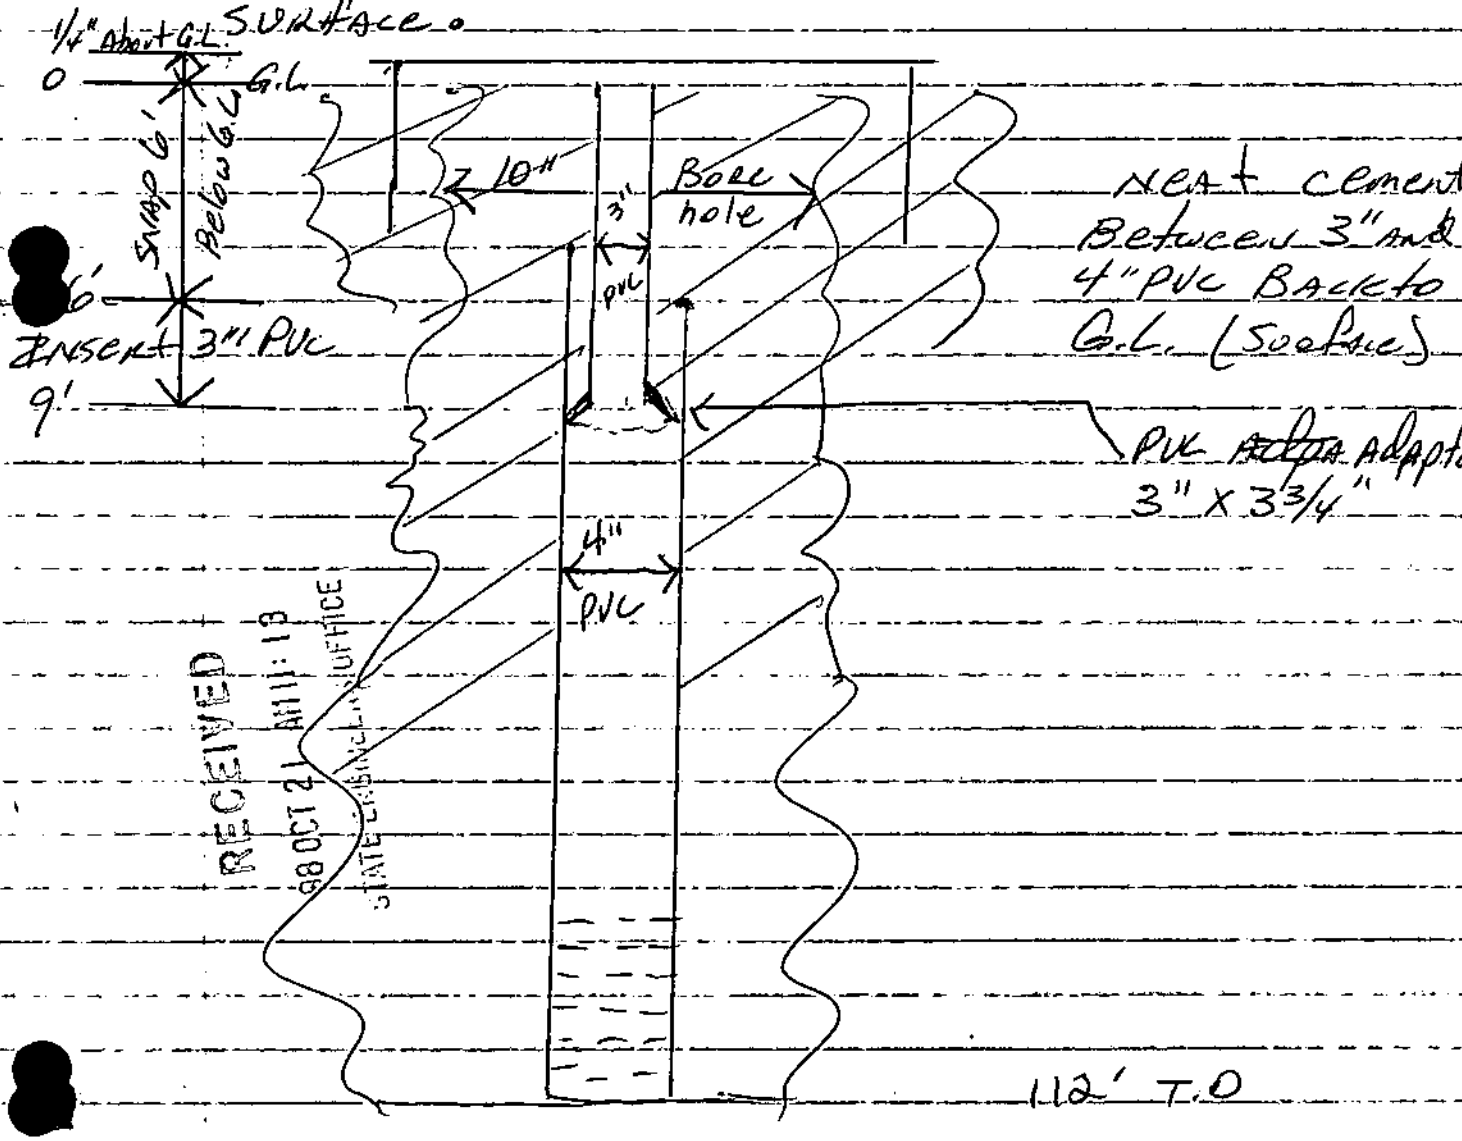

RECEIVED
98 OCT 21 AM 11:18
STATE ENGINEER'S OFFICE