WHITE—DIVISION OF WATER RESOURCES
CANARY—CLIENT'S COPY
PINK—WELL DRILLER'S COPY

PRINT OR TYPE ONLY
DO NOT WRITE ON BACK

STATE OF NEVADA
DIVISION OF WATER RESOURCES

WELL DRILLER'S REPORT

Please complete this form in its entirety in accordance with NRS 534.170 and NAC 534.340

OFFICE USE ONLY
Log No. 91493
Permit No.
Basin 212

NOTICE OF INTENT NO. 24909

1. OWNER The Essinger Family Trust
MAILING ADDRESS 12932 N 136th St
Scottsdale AZ 85259
ADDRESS AT WELL LOCATION 5525 W. Charleston
Las Vegas NV

2. LOCATION NE ¼ NW ¼ Sec. 1 T 21 N/S R 60 E Clark County

PERMIT NO. ____ Issued by Water Resources | Parcel No. | Subdivision Name

3. WORK PERFORMED
☒ New Well ☐ Replace ☐ Recondition
☐ Deepen ☐ Abandon ☐ Other

4. PROPOSED USE
☐ Domestic ☐ Irrigation ☐ Test
☐ Municipal/Industrial ☒ Monitor ☐ Stock

5. WELL TYPE
☐ Cable ☐ Rotary ☐ RVC
☐ Air ☒ Other Auger

6. MW-112 LITHOLOGIC LOG

Material	Water Strata	From	To	Thickness
Fill		5'	60'	55'
Sand reddish brown w/course gravel		60'	13'	7'
sandy clay, reddish brown, dry		13'	21'	8'
silty sand w/clay course gravel		21'	27'	6'
silty clay brown w/gravel		27'	38'	11'
caliche		38'	52'	14'
silty clay, slight odor		52'	78'	26'

Date started Sep 12, 1903
Date completed Sep 12, 1903

7. WELL TEST DATA
TEST METHOD: ☐ Bailer ☐ Pump ☐ Air Lift

G.P.M.	Draw Down (Feet Below Static)	Time (Hours)

8. WELL CONSTRUCTION
Depth Drilled 75 Feet, Depth Cased 75 Feet

HOLE DIAMETER (BIT SIZE)

Inches	From Feet	To Feet
9	75	75

CASING SCHEDULE

Size O.D. (Inches)	Weight/Ft. (Pounds)	Wall Thickness (Inches)	From (Feet)	To (Feet)
4.5	DVC	Sch 40	0	75

Perforations:
Type perforation Factory Slot
Size perforation .020
From 45 feet to 75 feet
From ____ feet to ____ feet
From ____ feet to ____ feet
From ____ feet to ____ feet
From ____ feet to ____ feet

Surface Seal: ☒ Yes ☐ No
Depth of Seal 40 to surface
Placement Method: ☐ Pumped ☒ Poured

Seal Type:
☒ Neat Cement
☐ Cement Grout
☐ Concrete Grout

Gravel Packed: ☒ Yes ☐ No
From 40 feet to 75 feet

9. WATER LEVEL
Static water level 63 feet below land surface
Artesian flow ____ G.P.M. ____ P.S.I.
Water temperature ____ °F Quality ____

10. DRILLER'S CERTIFICATION
This well was drilled under my supervision and the report is true to the best of my knowledge.
Name Elite Drilling Inc (Contractor)
Address 5115 S. Industrial Rd #104 (Contractor)
Las Vegas NV 89118
Nevada contractor's license number issued by the State Contractor's Board 0054931
Nevada driller's license number issued by the Division of Water Resources, the ~~on-site driller~~ M1869
Signed ____ By driller performing actual drilling on site or contractor
Date 11-12-03

(Rev. 3-91) USE ADDITIONAL SHEETS IF NECESSARY (O)-627

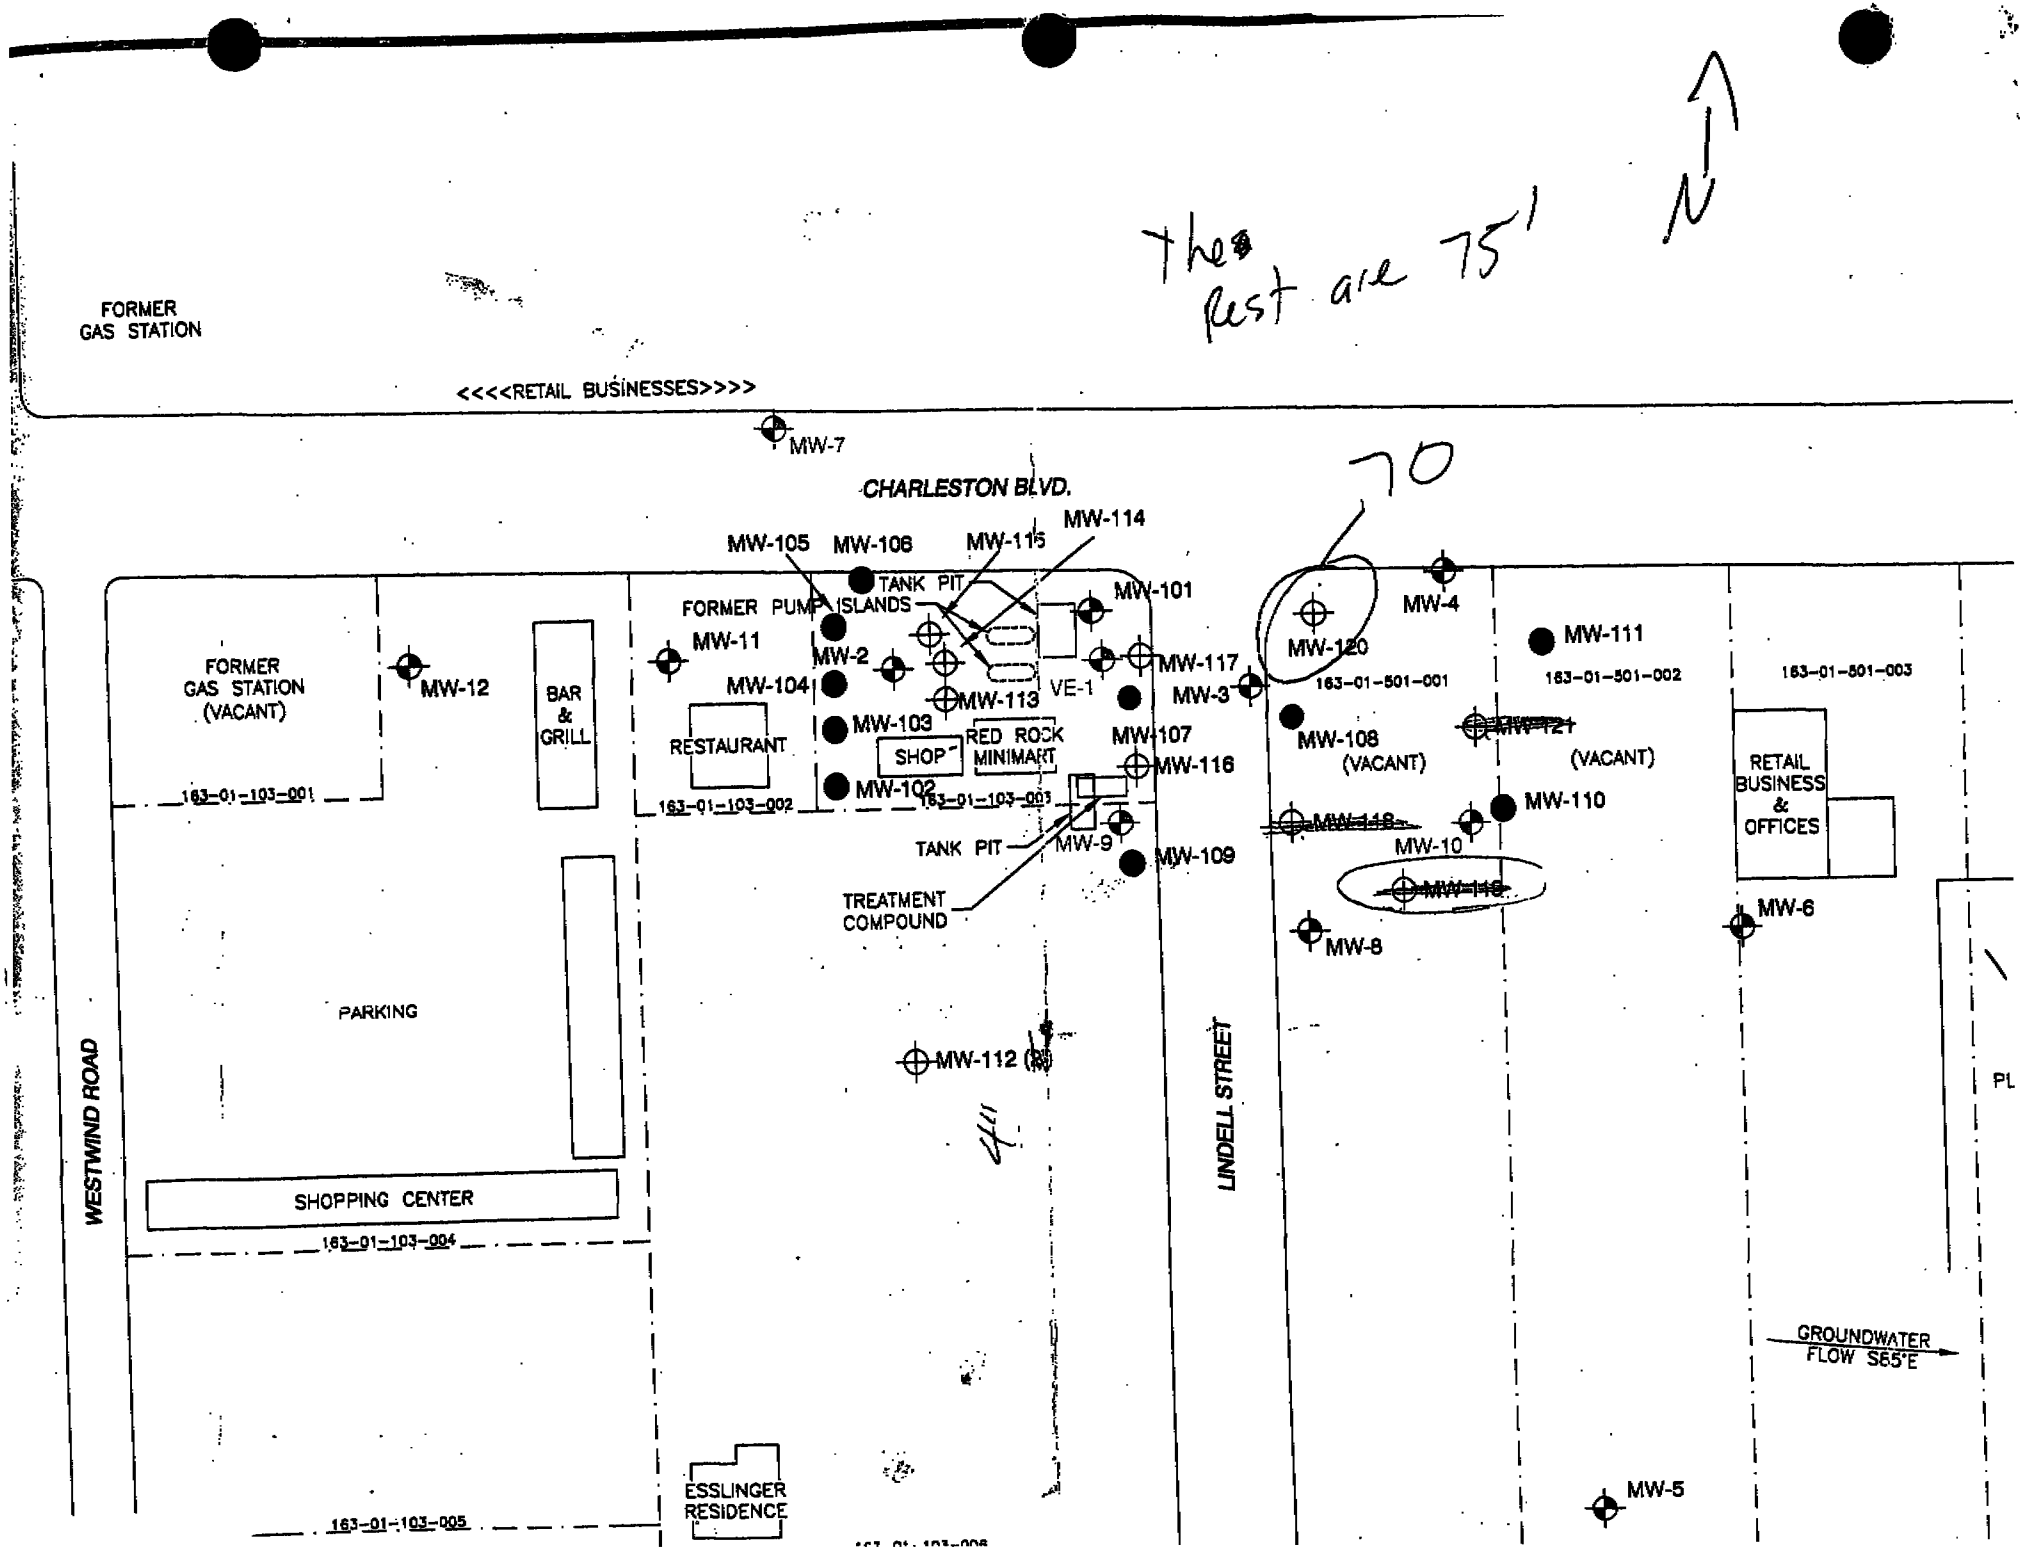

The rest are 75'
N
FORMER GAS STATION
<<<<RETAIL BUSINESSES>>>>
MW-7
CHARLESTON BLVD.
70
MW-105
MW-106
MW-115
MW-114
TANK PIT
FORMER PUMP ISLANDS
MW-101
MW-4
MW-11
MW-2
MW-117
MW-120
MW-111
FORMER GAS STATION (VACANT)
MW-12
BAR & GRILL
MW-104
MW-113
VE-1
MW-3
163-01-501-001
163-01-501-002
163-01-501-003
RESTAURANT
MW-103
SHOP
RED ROCK MINIMART
MW-107
MW-108
(VACANT)
MW-121
(VACANT)
RETAIL BUSINESS & OFFICES
MW-116
MW-102
163-01-103-001
163-01-103-002
163-01-103-003
MW-110
MW-118
TANK PIT
MW-9
MW-109
MW-10
MW-119
TREATMENT COMPOUND
MW-6
MW-8
PARKING
MW-112
LINDELL STREET
WESTWIND ROAD
SHOPPING CENTER
163-01-103-004
GROUNDWATER FLOW S65°E
ESSLINGER RESIDENCE
MW-5
163-01-103-005