WHITE—DIVISION OF WATER RESOURCES
CANARY—CLIENT'S COPY
PINK—WELL DRILLER'S COPY

PRINT OR TYPE ONLY
DO NOT WRITE ON BACK

STATE OF NEVADA
DIVISION OF WATER RESOURCES

WELL DRILLER'S REPORT

Please complete this form in its entirety in accordance with NRS 534.170 and NAC 534.340

OFFICE USE ONLY
Log No. 92454
Permit No.
Basin 53

NOTICE OF INTENT NO. 51833

1. OWNER Bac Tech, Tonkin Springs
MAILING ADDRESS 249 3rd St.
Elko, Nevada 89801
ADDRESS AT WELL LOCATION R-03-TH1

2. LOCATION NE ¼ NE ¼ Sec. 29 T 24 N/S R 49 E Eureka County
PERMIT NO. M/O-1302 (Issued by Water Resources) | Parcel No. | Subdivision Name

3. WORK PERFORMED
[X] New Well [ ] Replace [ ] Recondition
[ ] Deepen [ ] Abandon [ ] Other

4. PROPOSED USE
[ ] Domestic [ ] Irrigation [ ] Test
[ ] Municipal/Industrial [X] Monitor [ ] Stock

5. WELL TYPE
[ ] Cable [ ] Rotary [X] RVC
[ ] Air [ ] Other

6. LITHOLOGIC LOG

Material	Water Strata	From	To	Thickness
Lime Stone	UA	0	350'	350'

Materials Used:
10' x 6 5/8" casing with 4, 94 lbs bags Nevada Cement and Surface Casing 2, 50 lbs bags W-60

47, #12-20 100 lbs Bags sand
7, Nevada 94 lbs Bags cement for Surface Seal
2, 50 lbs Hole Plug Medium between Sand and Cement

well Construction
2" Sch 80 Blank 2' above ground level from Ground level down to 58' 10 Ft Sections of Blank; 58'-348' Alternating 10' Sections of Blanks and 10' Screens

Date started 11-5-03, 19
Date completed 11-6-03, 19

7. WELL TEST DATA
TEST METHOD: [ ] Bailer [ ] Pump [ ] Air Lift

G.P.M.	Draw Down (Feet Below Static)	Time (Hours)

8. WELL CONSTRUCTION
Depth Drilled 350' Feet Depth Cased 348 Feet

HOLE DIAMETER (BIT SIZE)

		From		To	
10	Inches	0	Feet	10	Feet
6	Inches	10'	Feet	350'	Feet
	Inches		Feet		Feet

CASING SCHEDULE

Size O.D. (Inches)	Weight/Ft. (Pounds)	Wall Thickness (Inches)	From (Feet)	To (Feet)
2"		Sch 80	+2	58

Perforations:
Type perforation Horizontal Slot
Size perforation .020
From feet to feet
From feet to feet
From feet to feet
From feet to feet
From feet to feet

Surface Seal: [X] Yes [ ] No
Depth of Seal 50'
Placement Method: [ ] Pumped [X] Poured
Seal Type: [X] Neat Cement [ ] Cement Grout [ ] Concrete Grout

Gravel Packed: [X] Yes [ ] No
From 50' feet to 350' feet

9. WATER LEVEL
Static water level Dry feet below land surface
Artesian flow G.P.M. P.S.I.
Water temperature °F Quality

10. DRILLER'S CERTIFICATION
This well was drilled under my supervision and the report is true to the best of my knowledge.
Name Eklund Drilling (Contractor)
Address PO Box 2748 (Contractor)
Elko Nevada 89803
Nevada contractor's license number issued by the State Contractor's Board 0030823
Nevada driller's license number issued by the Division of Water Resources, the on-site driller M2100
Signed [signature] (By driller performing actual drilling on site or contractor)
Date 11-6-03

(Rev. 3-91) USE ADDITIONAL SHEETS IF NECESSARY (O)-627

LYNTEK Computation Sheet

Page 1 of 1

Tonkin Spring Project

Made by Randall K Stoeberl

Client BacTech ~~Job~~ Hole No. R-03-TH1

Date 11

Subject Water Well Drawing

Checked by

vertical scale 1" = 40' : Horizontal - not to scale

Date

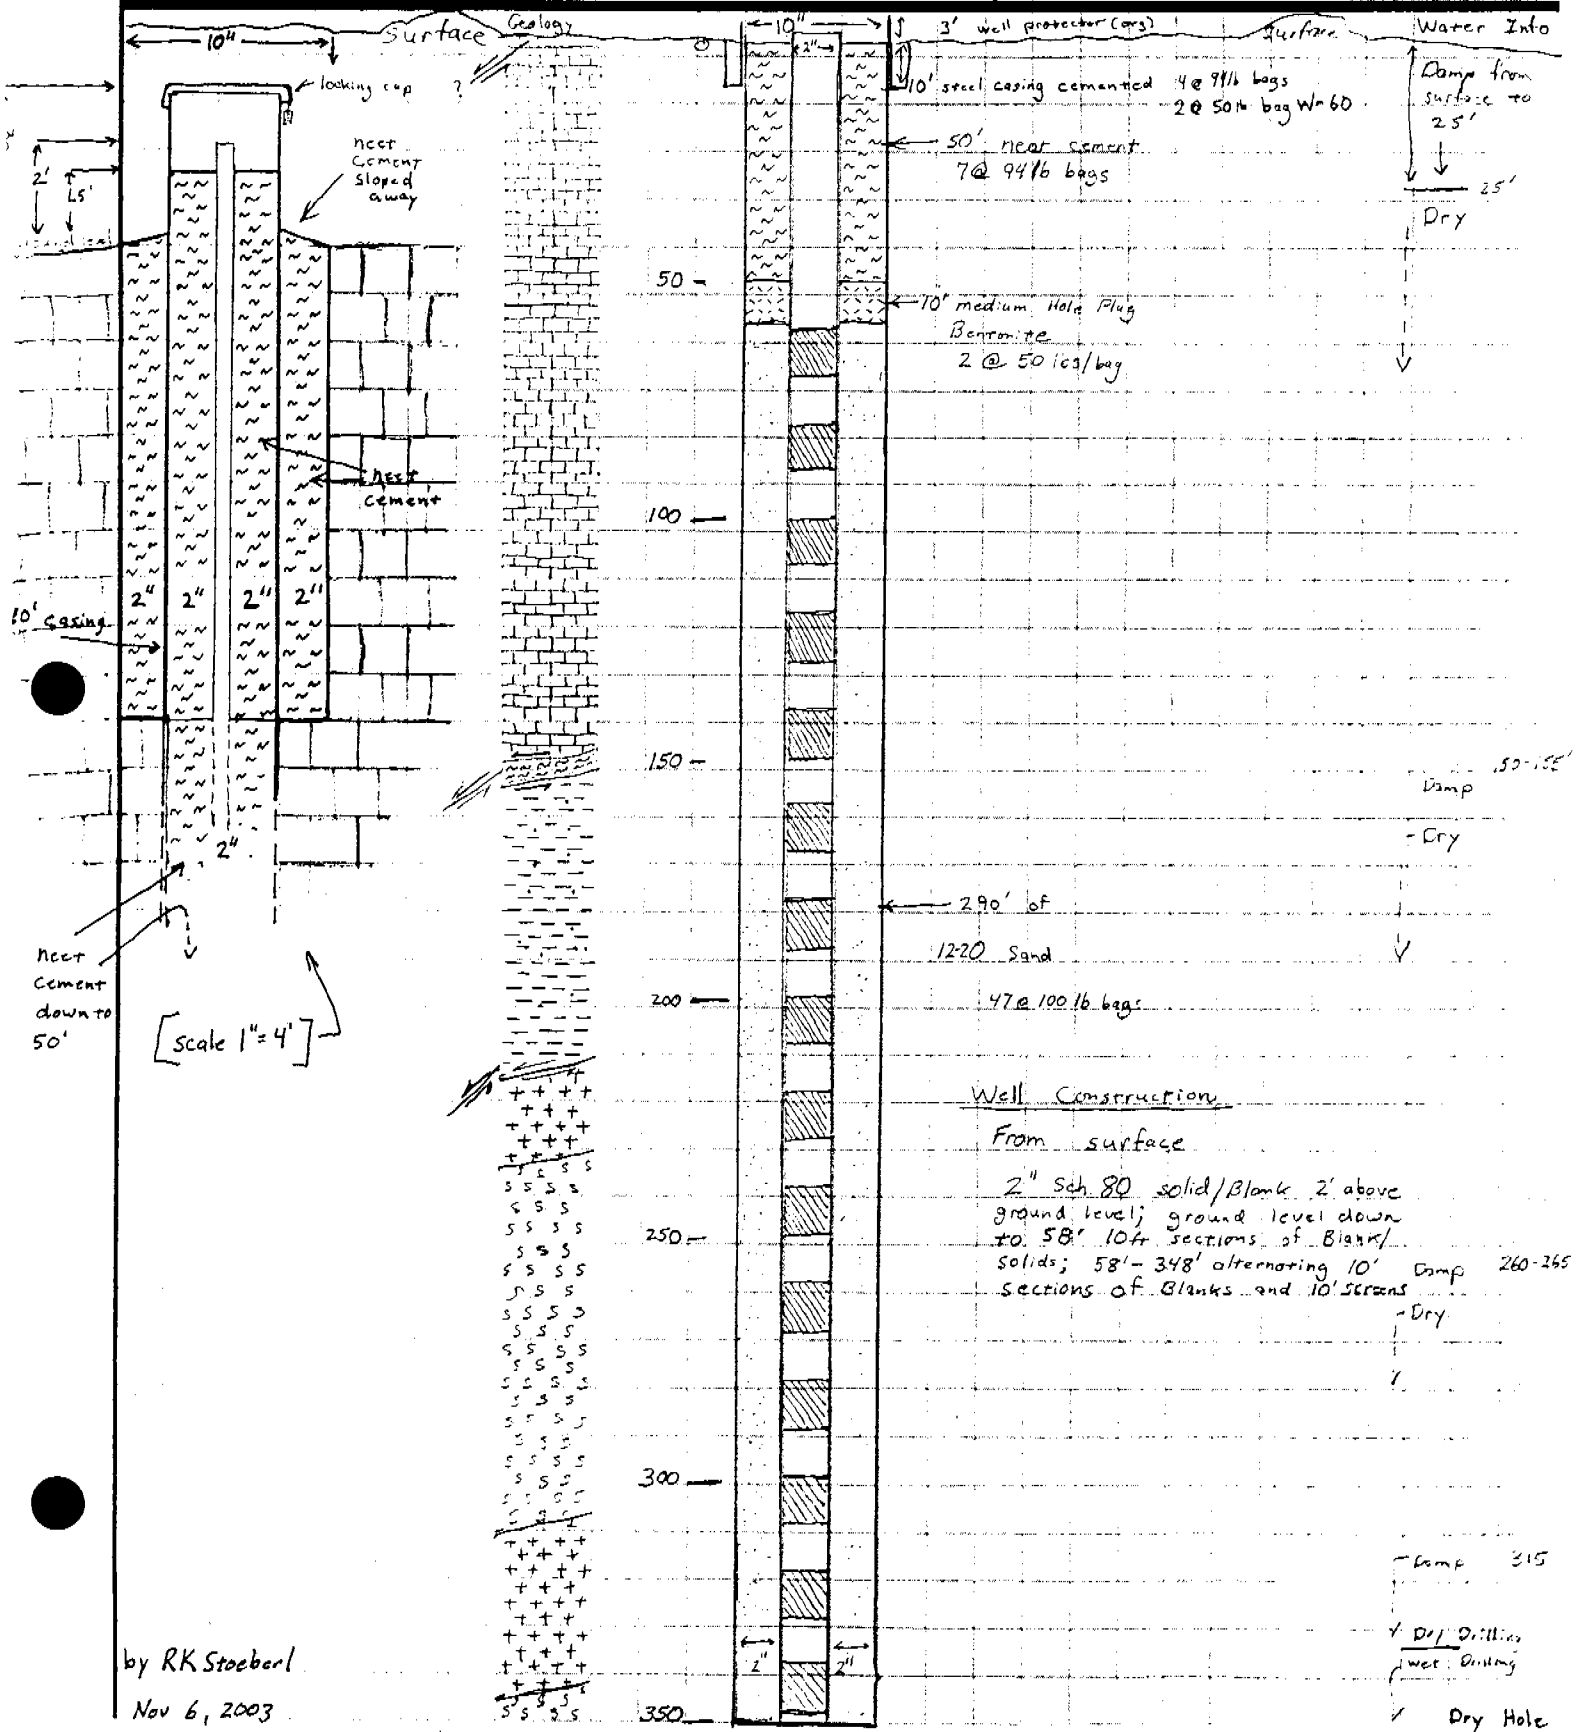

by RK Stoeberl

Nov 6, 2003